




# Adjustment Provisions for Water Loss Performance Standards

Kartiki Naik  
State Water Resources Control Board




February, 2019

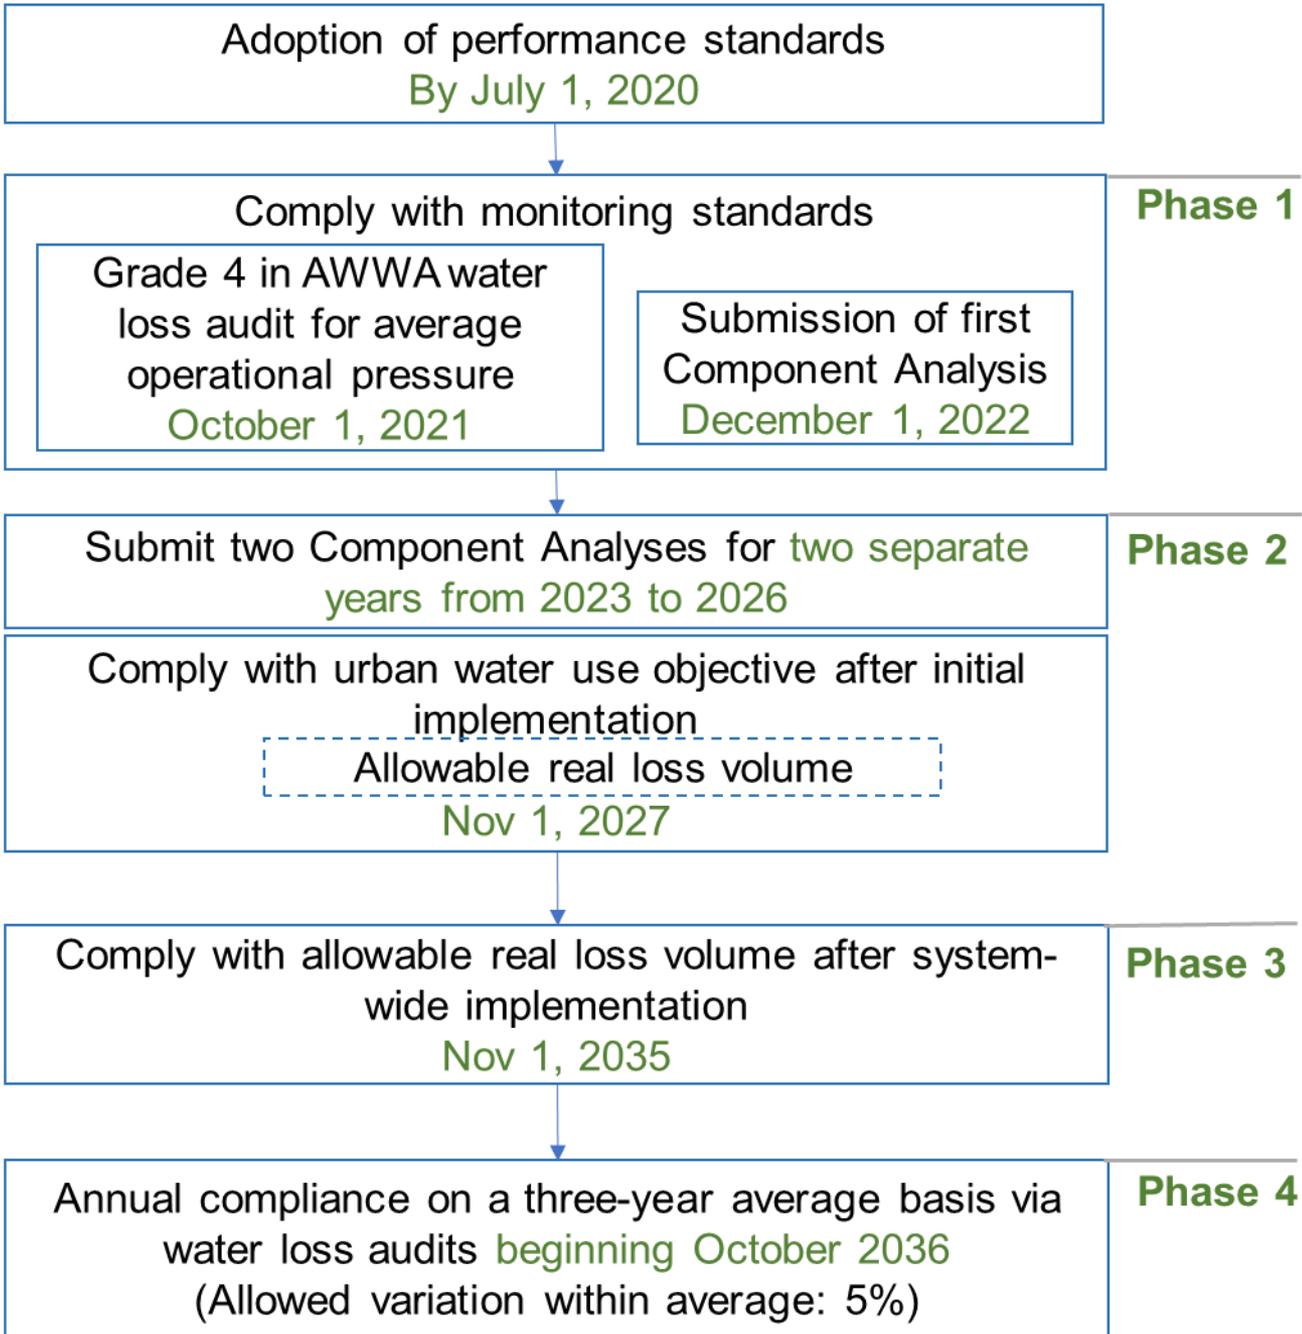

# Need for Adjustments



Inability to build capacity for timely compliance

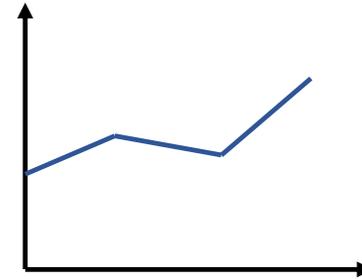

Data variability




New data



System constraints

# Phase 1


## Improved data collection and quality

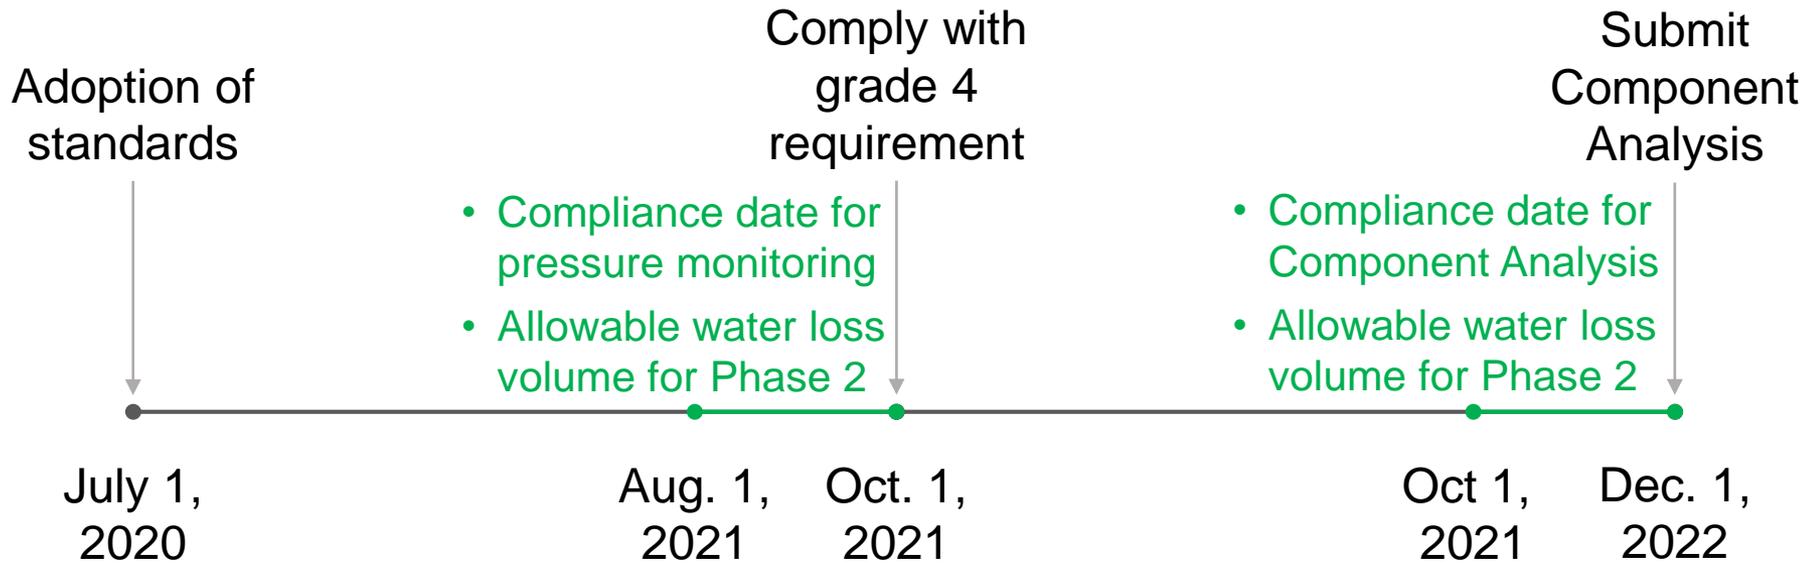

—●— Period to request adjustment specified in green text


# Phase 2

## Initial Implementation

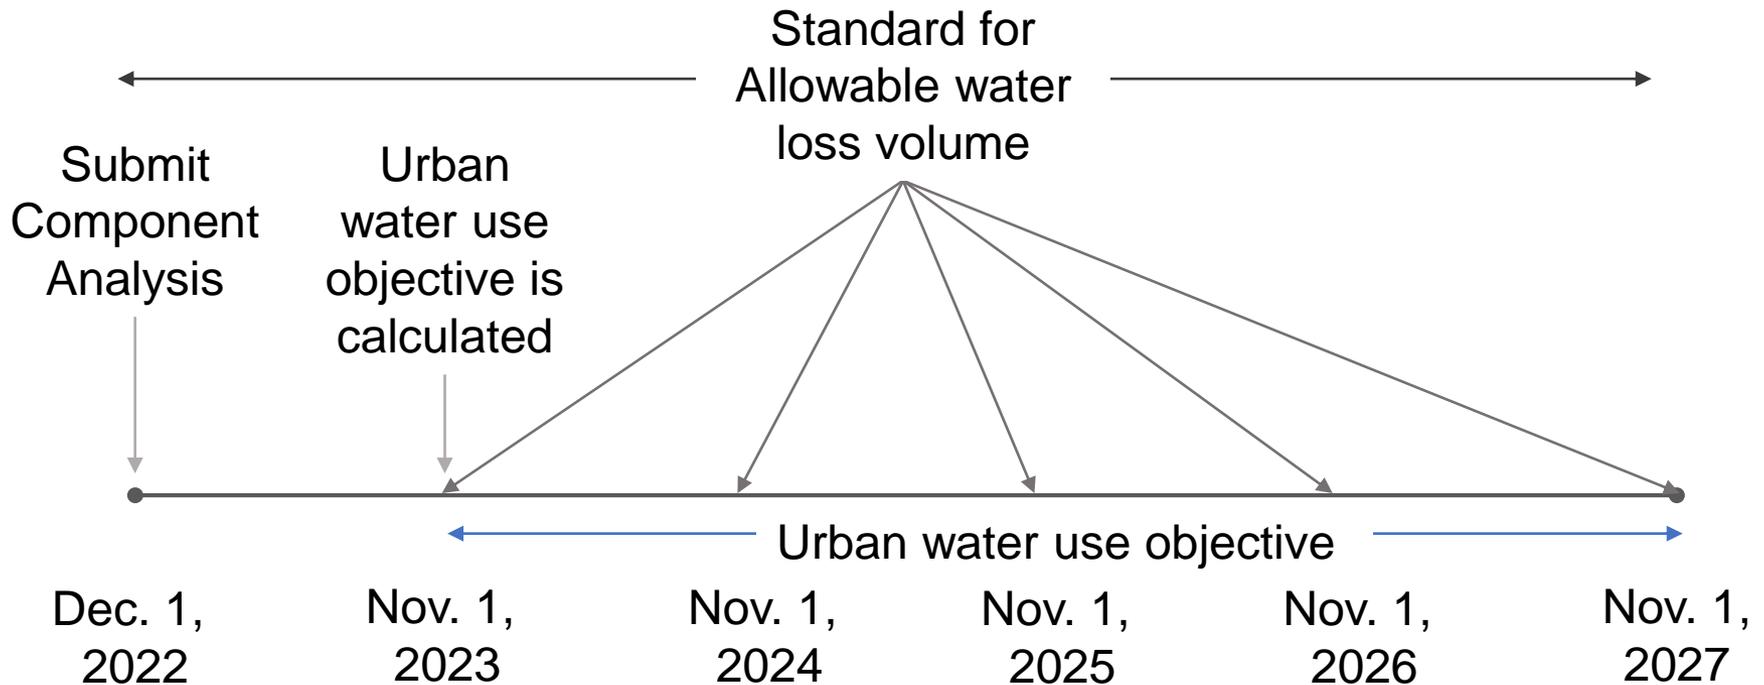

# Phase 2

## Initial Implementation

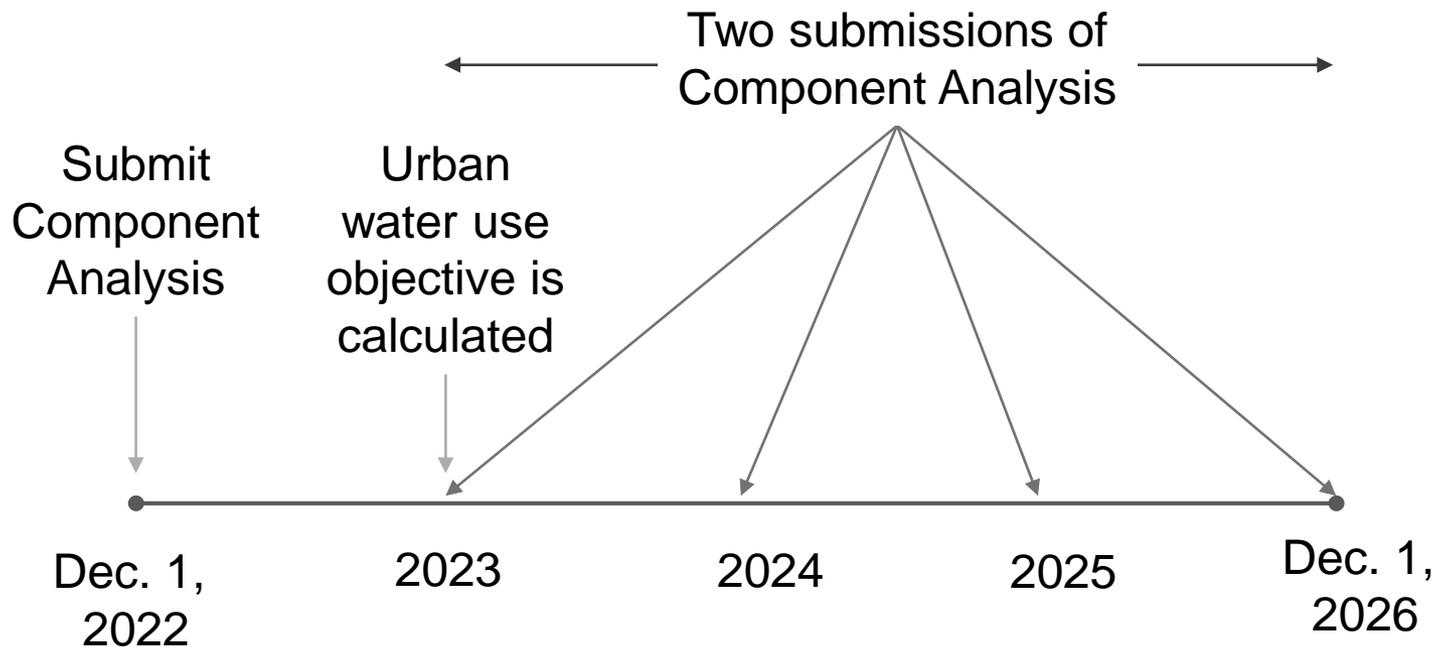

# Phase 2


## Initial Implementation



—●— Period to request adjustment specified in green text

# Phase 3

## System-wide Implementation

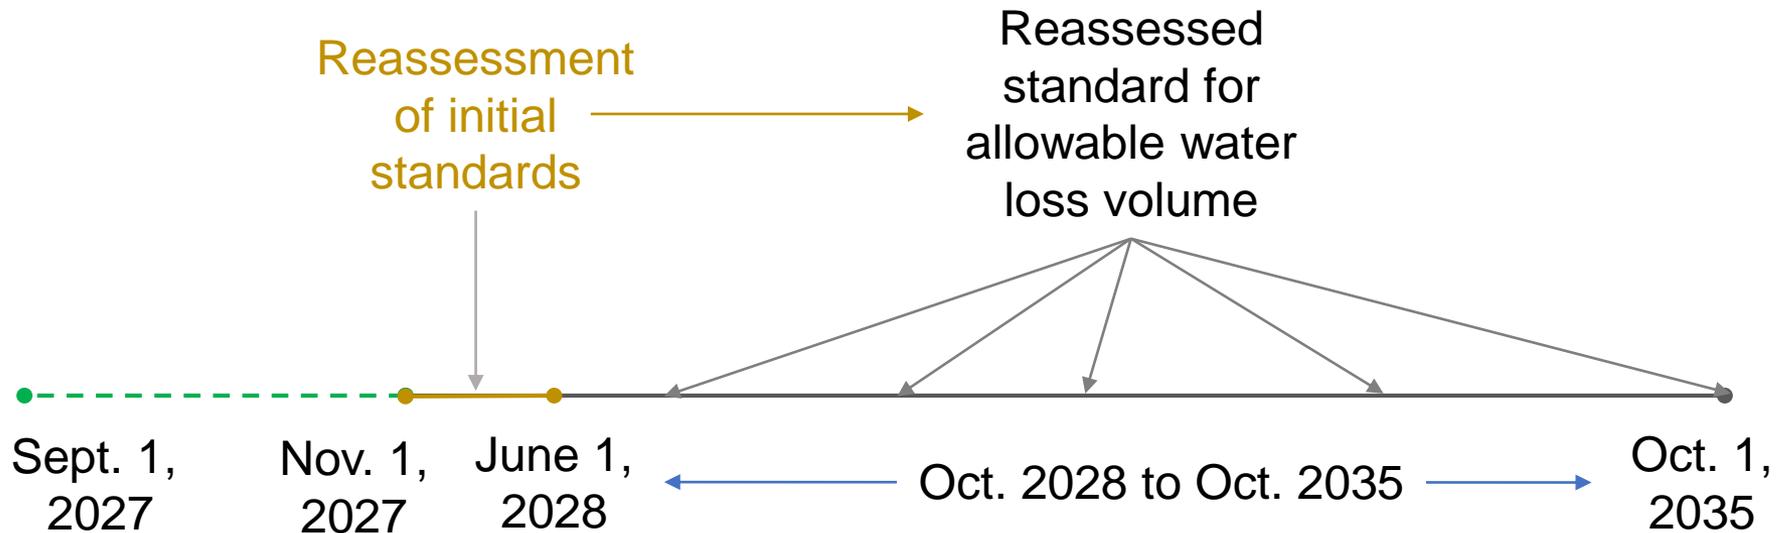


● - - - ● Period to request adjustment in Phase 2

● — ● Reassessment by State Water Board

# Phase 4

## Ongoing Water loss Control

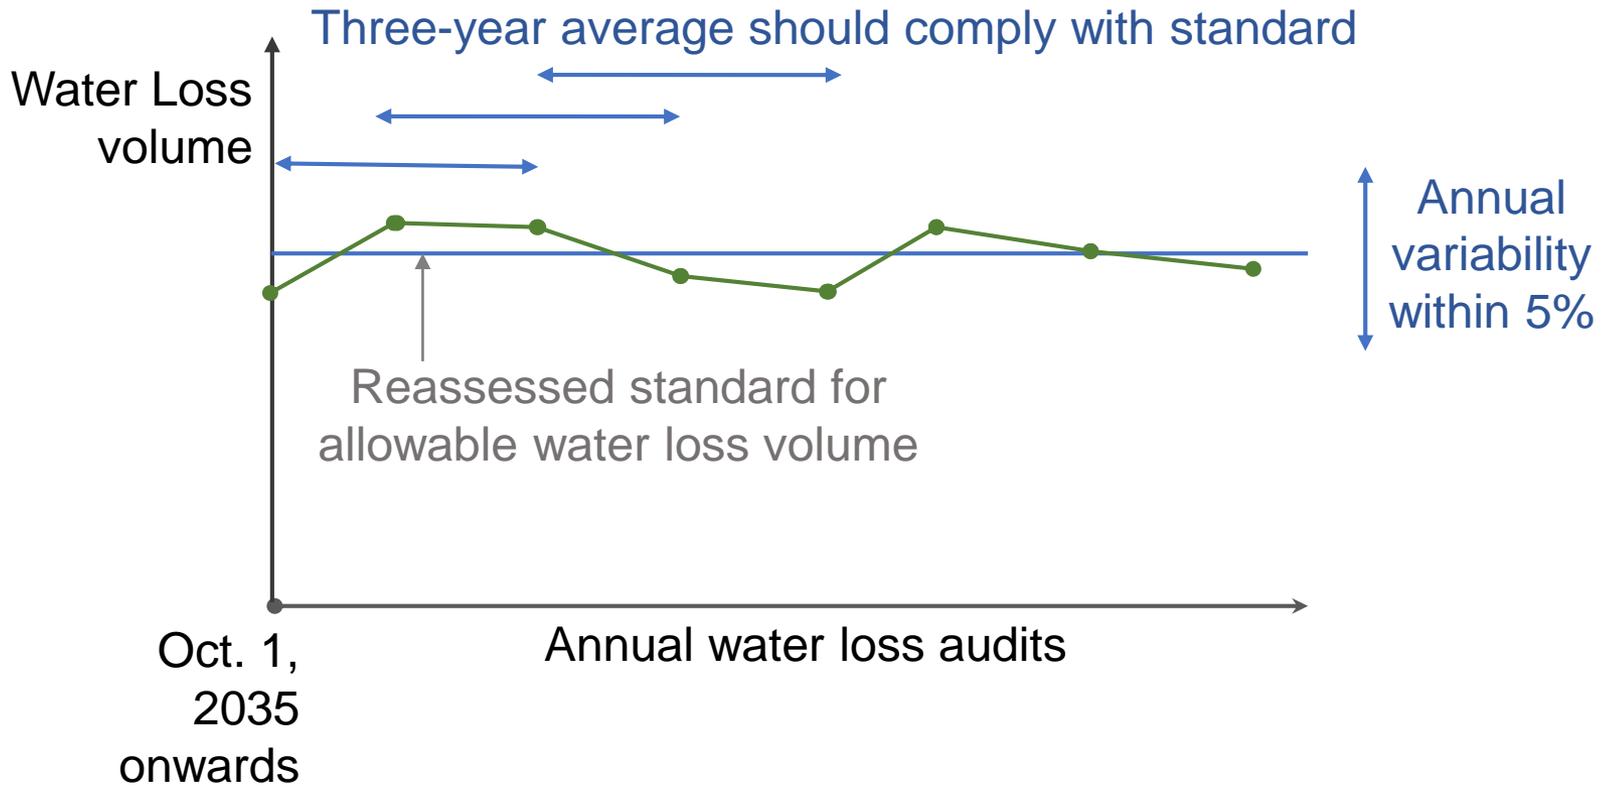

# Summary

